


Main Contents of the Amendment

- Change the number of facilities for making sure to deal with specific severe accidents
 - Change the number of water injection pump for cooling inside of reactor and containment vessel
 - Change the number of generator to deal with specific severe accidents
- Extension and revision of layout of the building in accordance with the change the number of facilities
- Enhancement of description regarding facility operation procedures to deal with Specific severe accidents

(Reference) Diagram of Specific Safety Facilities

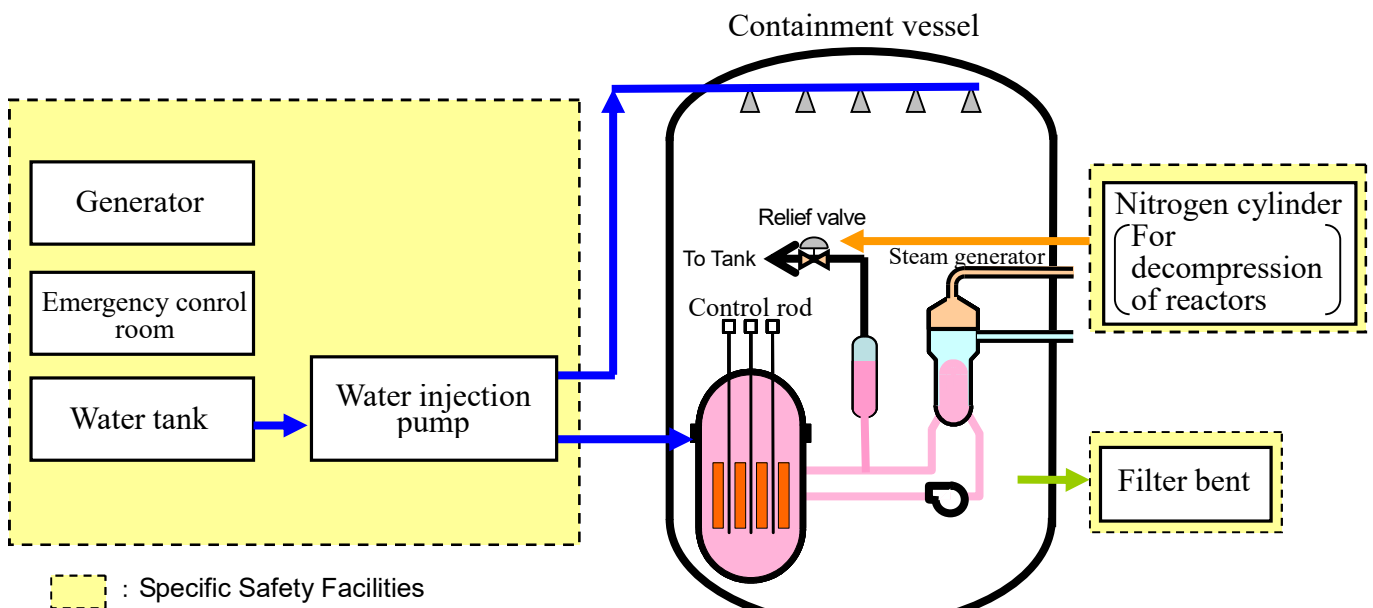

Note: Filter bent

The equipment which releases steam and decreases pressure in a containment vessel, for preventing damage of it in case that the pressure in it increases abnormally, and suppresses radioactive materials which are released into the air.